


INSTRUCTIONS SEAL TITE COVERS



When cable diameter is greater than *ring diameters "A"*—cut off flush with next larger diameter rings.

Under no circumstances cut off more than three rings.

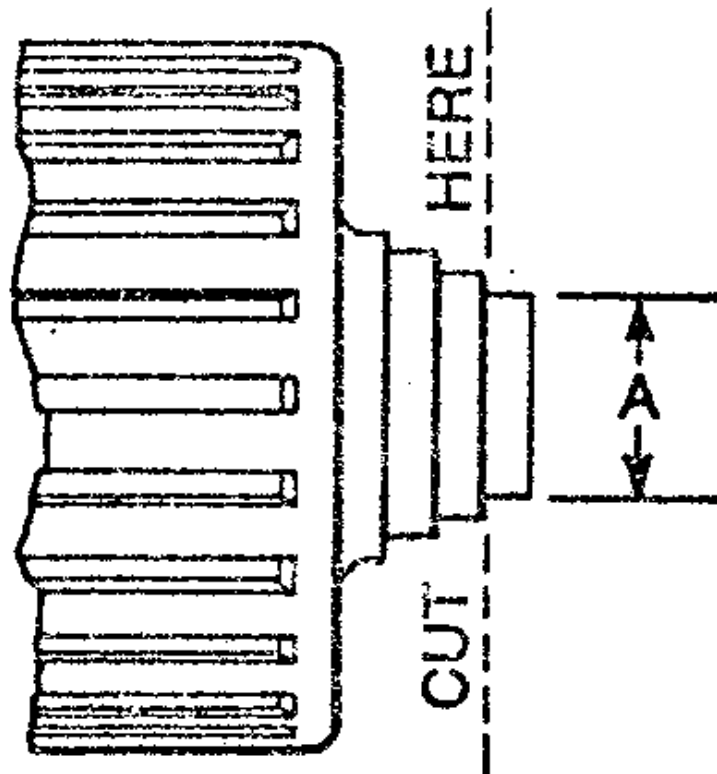

wiring device division

Wiring Device Division HARVEY HUBBELL INCORPORATED

FORM 552